

WOLTERS ENGINEERING

ENGINEERING, DRAFTING, CONSULTING

15211 97th Road N
West Palm Beach, FL 33412
Ph/Fx: (561) 225-1982

PRODUCT EVALUATION **(FOR HVHZ APPROVED PRODUCT)**

PRODUCT: **DM CLASS 100 SERIES 3/4" CORRUGATED 26 GA. GALVALUME
ROOF PANEL (FLPA# 30751.1)**

MANUFACTURER: DYNAMIC METALS, LLC
340 PIKE ROAD
WEST PALM BEACH, FL 33411

To all concerned,

The DM Class 100 Series 3/4" Corrugated 26 Ga. Galvalume Roof Panel, manufactured by Dynamic Metals LLC, is a non-structural galvalume coated Fluoropon painted steel roof panel (50 ksi min) that meets the requirements of Sections 1507.4 and 1518.9 of the 7th Edition (2020) Florida Building Code. The panel has been tested per TAS 100 and TAS 125 by Intertek with results shown in test reports K2132.01-450-18 and K2132.09-450-44, and per TAS 110 by PRI Construction Materials Technologies, with results shown in test reports VLS-004-02-01 and VLS-005-02-01.

Technical Documentation:

1. Drawing "100CSHZ" dated 2/12/20, signed and sealed by Scott Wolters, PE.
2. Test Reports listed above by Architectural Testing, Inc. signed and sealed by Vinu Abraham, PE, and by PRI Construction Materials Technologies, signed and sealed by Zachary R Priest, PE.
3. Supplemental Calculations to support "100CSHZ" drawing, signed and sealed by Scott Wolters, PE.

I have reviewed this submittal per the requirements of FAC Product Approval Rule Chapter 61G20-3.005 (4). Based on the limitations listed below and those provided in the documents above, this product meets all the requirements of the 7th Edition (2020) Florida Building Code generally, and chapter 15 specifically, including the HVHZ provisions.

Limitations: **This panel is approved for use inside and outside of the HVHZ.**

<u>Overall Limitations:</u>	Maximum Panel Width:	34 1/2" or 24 3/8" (Nominal)
	Max. Coverage Width:	29 1/2" (34 1/2" with 2 Ribs Over-Lapping) Or 21" (24 3/8" with 1 Rib Over-Lapping)
	Minimum Panel Height:	3/4"
	Min. Slope:	2/12 (HVHZ) 1/2/12 (Non-HVHZ, with Lap Sealant) 3/12 (Non-HVHZ, No Lap Sealant)

	Field Installation	Perimeter & Corner Installation
Max. Design Pressure:	-101 psf	-161 psf
Fastener Spacing: (Across Panel)	6" O.C.	6" O.C.
Fastener Spacing: (Along Panel)	4" From Ends, 24" Max. O.C.	4" From Ends, 12" Max O.C.
Min Panel Fasteners:	#9x2" HWH Fasteners with Weather-Seal Washer	#9x2" HWH Fasteners with Weather-Seal Washer

Fire Barrier: Where required by code, install an approved fire barrier. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. (See note #2 below)

Note: Outside of the HVHZ, 1" round plastic caps meeting the requirements of FBC Section 1507.1.1.1, may be used to prevent galvanic reactions.

Underlayment: Minimum ASTM D 226 Type II, installed and anchored per FBC Section 1507.1.1.1 (min).

(or)

Any underlayment with a valid FLPA or Miami-Dade NOA

Note: Outside of the HVHZ, 1" round plastic caps meeting the requirements of FBC Section 1507.1.1.1 may be used to prevent galvanic reactions.

Minimum Substrate: 1/2" (15/32" min) 4-ply CDX Plywood or 3/4" solid wood planks (S.G.= 0.42 min) nailed to 2x rafters spaced 24" max. on center with 8d ring-shank nails spaced 6" on center.

Note: The 3/4" wood planking must be installed as a solid deck and must be nailed or fastened in a manner equal to the deck above, or as specified by a Florida licensed Architect/Engineer

Other Limitations:

1. Roof slope must meet requirements of FBC Sections 1507.4.2 or 1515.2.
2. Fire classification is not a part of this evaluation. Refer to a current Approved Roofing Materials Directory for fire ratings of this product.

3. Design of substrate is by others and is not a part of this evaluation.
4. Rational analysis, provided by a Florida licensed Architect/Engineer per FAS 61G20.3.005(e), may be used for project specific approval by the local authorities having jurisdiction.
5. Where required by code, all panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement, "Dynamic Metals FL# 30751.1, DM Class 100".

Panel Forming:

These panels may be jobsite roll formed with the following Dynamic Metals machines, per approval of 3rd party QA provider, to the dimensions shown on Drawing 100CSHZ:

SSQ-6800617
SSQ-6690517
5VC-0490718

SSQ-5150216
SSQ-4560615
5VC-0360516

SSQ-6810617
SSQ2-2310920
SSQ2-2320920


Re-Roofing:

The DM Class 100 Series 3/4" Corrugated 26 Ga. Galvalume Roof Panel may be installed over a single layer of existing asphalt shingles, provided the existing roof meets the requirements of Section 1521 (HVHZ) or Section 1511 (outside of HVHZ) of the Florida Building Code.



If you have any questions or need more information concerning this approval, please contact me.

Thank you,


Scott Wolters
FL PE# 62354
AUG 23 2020

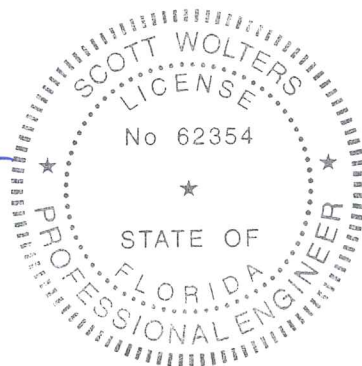

DM CLASS 100 3/4" CORRUGATED 26 GA. STEEL ROOF PANEL - 29 1/2" WIDTH

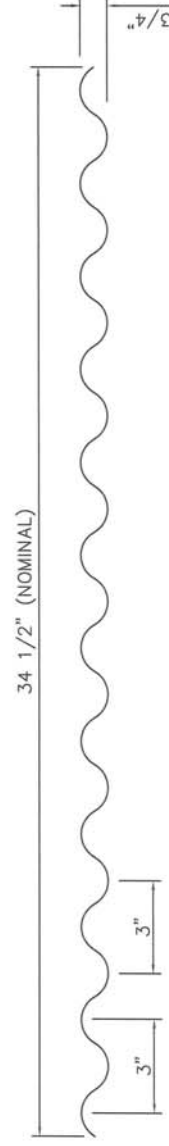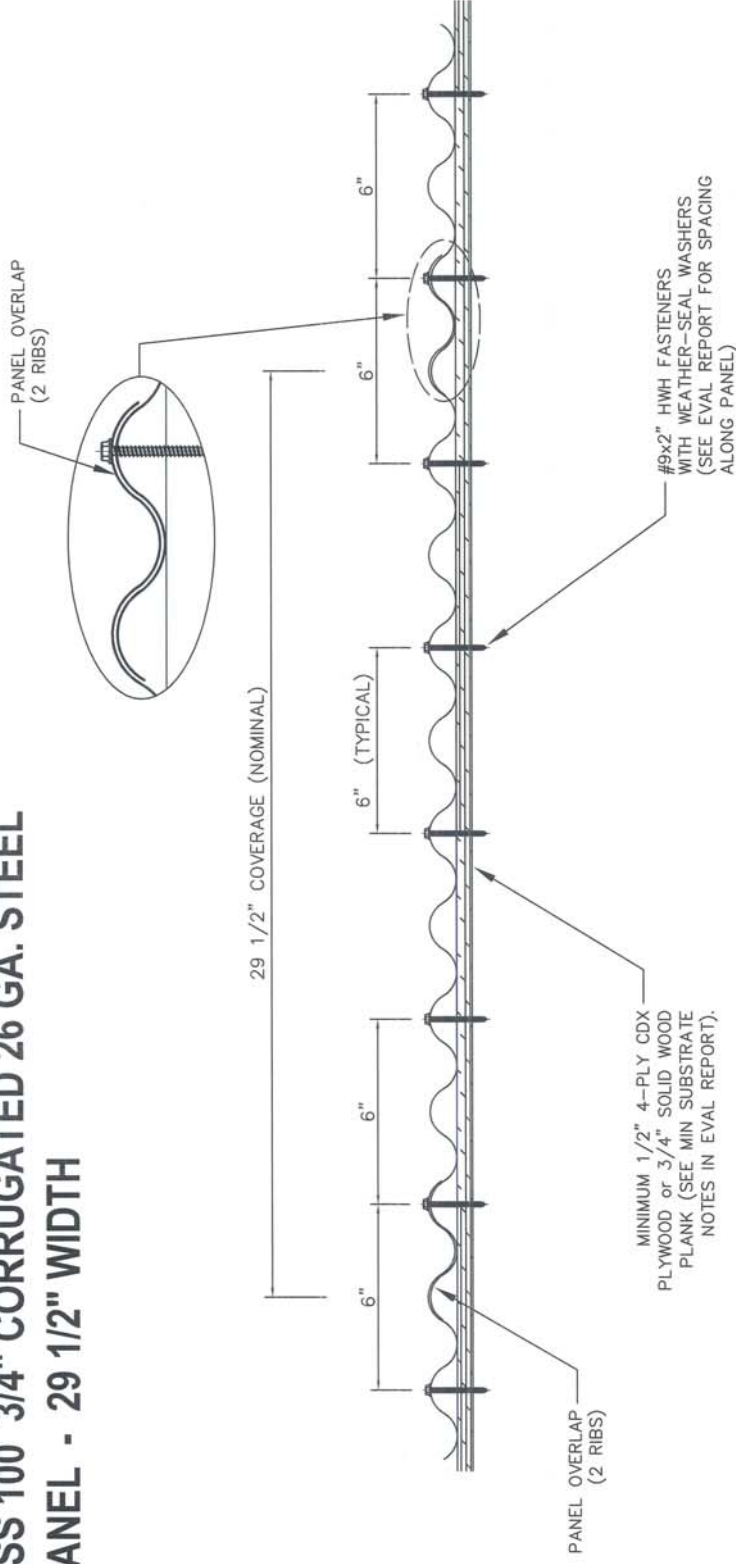

PANEL PROFILE

DYNAMIC METALS

340 PIKE ROAD
WEST PALM BEACH, FL 33782
PH: (561) 629-7288
FAX: (561) 629-7291
www.dynamictmetals.net
EMAIL: info@dynamictmetals.net




DWG: 100CSHZ
SHEET: 1/2



REV.#	DATE	PRINTS ISSUED FOR
1	12/20	1ST SUBMITTAL
2		
3		
4		
5		
6		
7		
8		
9		
10		

**DM CLASS 100 3/4" CORRUGATED 26 GA. STEEL
ROOF PANEL - 21" WIDTH**

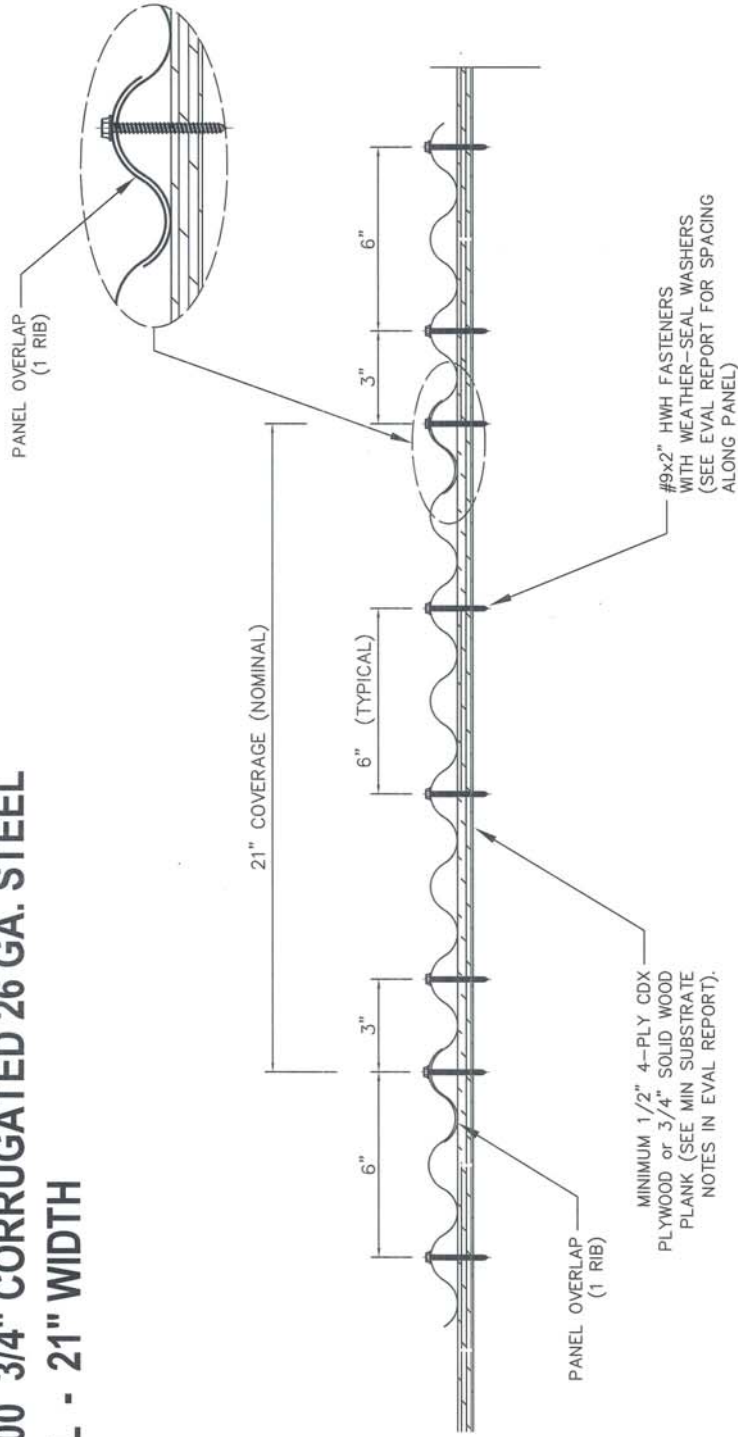

24 3/8" (NOMINAL)

3/4"

3"

3"

PANEL PROFILE

